

STAMFORD®

S0L1-J1 Winding 06

S0L1-J1 - Technical Data Sheet

Standards

Stamford industrial alternators meet the requirements of the relevant parts of the IEC EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100 and AS1359. Other standards and certifications can be considered on request.

Quality Assurance

Alternators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.



Excitation and Voltage Regulators

| | |
|----------------------------------|------------------|
| Excitation System | |
| AVR Type | AVR Power |
| AS540 | Self-Excited |
| Voltage Regulation | ± 1% |
| No Load Excitation Voltage (V) | 11 V |
| Full Load Excitation Voltage (V) | 41 V |

STAMFORD®

S0L1-J1 Winding 06

| Electrical Data | | |
|---|---|-------|
| Insulation System | Class H | |
| Stator Winding | Double Layer Concentric | |
| Winding Pitch | Two Thirds | |
| Winding Leads | 4 | |
| Winding Number | 06 | |
| Number of Poles | 4 | |
| IP Rating | IP 23 | |
| RFI Suppression | EN 61000-6-2 & EN 61000-6-4, refer to factory for others | |
| Waveform Distortion | NO LOAD < 2.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0% | |
| Short Circuit Ratio | 1/Xd | |
| Steady State X/R Ratio | N/A | |
| 60 Hz | | |
| Telephone Interference | TIF<75 | |
| Voltage Series | 240 | 240 |
| Power Factor | 0.8 | 1.0 |
| kVA Base Rating (Class H) | 9 | 9.7 |
| Saturated Values in Per Unit at Base Ratings and Voltages | | |
| Xd Dir. Axis Synchronous | 1.970 | 2.123 |
| X'd Dir. Axis Transient | 0.131 | 0.141 |
| X''d Dir. Axis Subtransient | 0.109 | 0.117 |
| Xq Quad. Axis Reactance | 0.867 | 0.934 |
| X''q Quad. Axis Subtransient | 0.172 | 0.185 |
| XL Stator Leakage Reactance | 0.062 | 0.067 |
| X2 Negative Sequence Reactance | 0.210 | 0.226 |
| X0 Zero Sequence Reactance | 0.070 | 0.075 |
| Unsaturated Values in Per Unit at Base Ratings and Voltages | | |
| Xd Dir. Axis Synchronous | 2.364 | 2.548 |
| X'd Dir. Axis Transient | 0.151 | 0.162 |
| X''d Dir. Axis Subtransient | 0.128 | 0.137 |
| Xq Quad. Axis Reactance | 0.893 | 0.962 |
| X''q Quad. Axis Subtransient | 0.206 | 0.222 |
| XL Stator Leakage Reactance | 0.070 | 0.076 |
| X2 Negative Sequence Reactance | 0.252 | 0.272 |
| X0 Zero Sequence Reactance | 0.082 | 0.088 |
| Time Constants (Seconds) | | |
| T'd TRANSIENT TIME CONST. | 0.018 | |
| T''d SUB-TRANSTIME CONST. | 0.001 | |
| T'do O.C. FIELD TIME CONST. | 0.407 | |
| Ta ARMATURE TIME CONST. | 0.01 | |

STAMFORD

S0L1-J1 Winding 06



| Resistances in Ohms (Ω) at 22°C | |
|--|--|
| Stator Winding Resistance (Ra) | 0.328 Ω per phase series connected |
| Rotor Winding Resistance (Rf) | 0.434 Ω |
| Exciter Stator Winding Resistance | 13.989 Ω |
| Exciter Rotor Winding Resistance | 0.093 Ω per phase |
| Positive Sequence Resistance (R1) | 0.410 Ω |
| Negative Sequence Resistance (R2) | 0.472 Ω |
| Zero Sequence Resistance (R0) | 0.410 Ω |
| Aux Winding Resistance | N/A |
| Mechanical data | |
| Cooling Air | 0.07 m ³ /sec (50Hz) |
| Shaft and Keys | All alternator rotors are dynamically balanced to better than BS6861: Part 1 Grade 2.5 for minimum vibration in operation. |
| Bearing | Single Bearing |
| Weight Comp. Alternator | 77.3 kg |
| Weight Wound Stator | 27.9 kg |
| Weight Wound Rotor | 26.8 kg |
| Moment of Inertia | 0.062 kgm ² |
| Shipping weight in a Crate | 115 kg |
| Packing Crate Size | 930X590X760 mm |
| Maximum Over Speed | 2250 RPM for two minutes |
| Bearing Drive End | N/A |
| Bearing Non-Drive End | Ball Bearing, 6305-2RS1 |

STAMFORD

S0L1-J1 Winding 06

Single Phase Efficiency Curves

60Hz

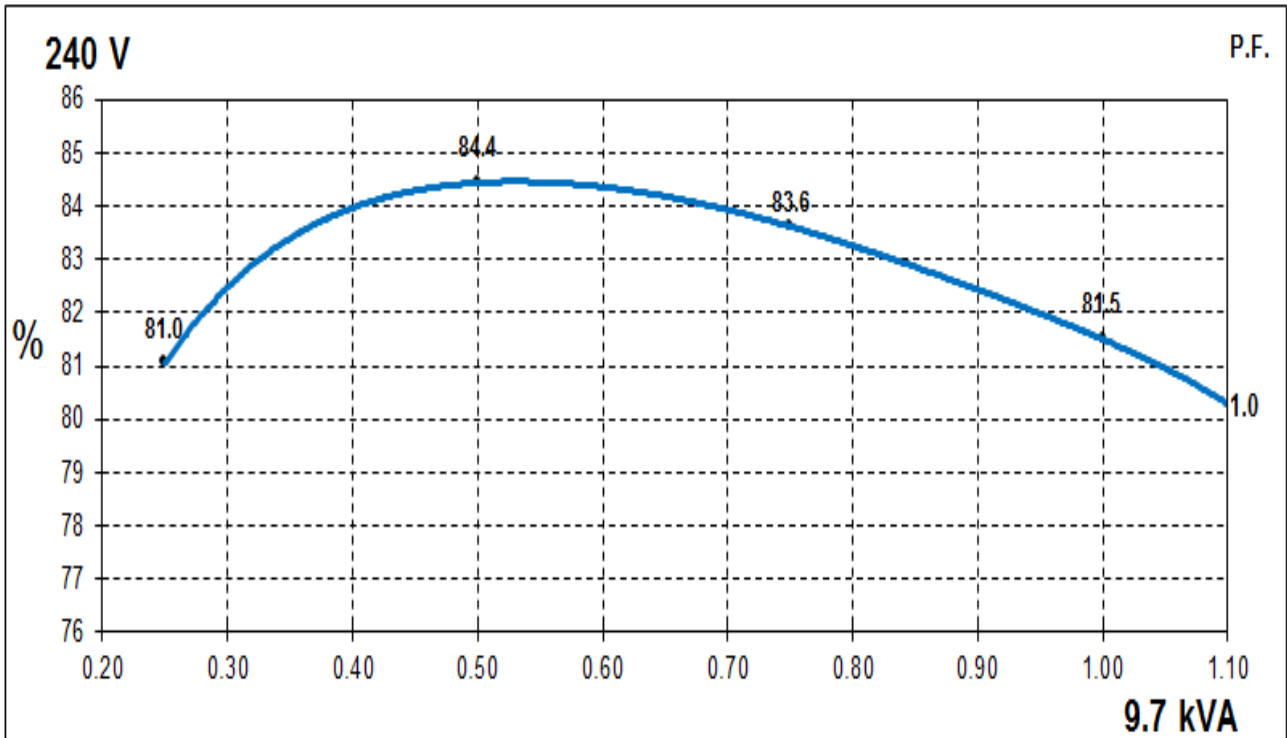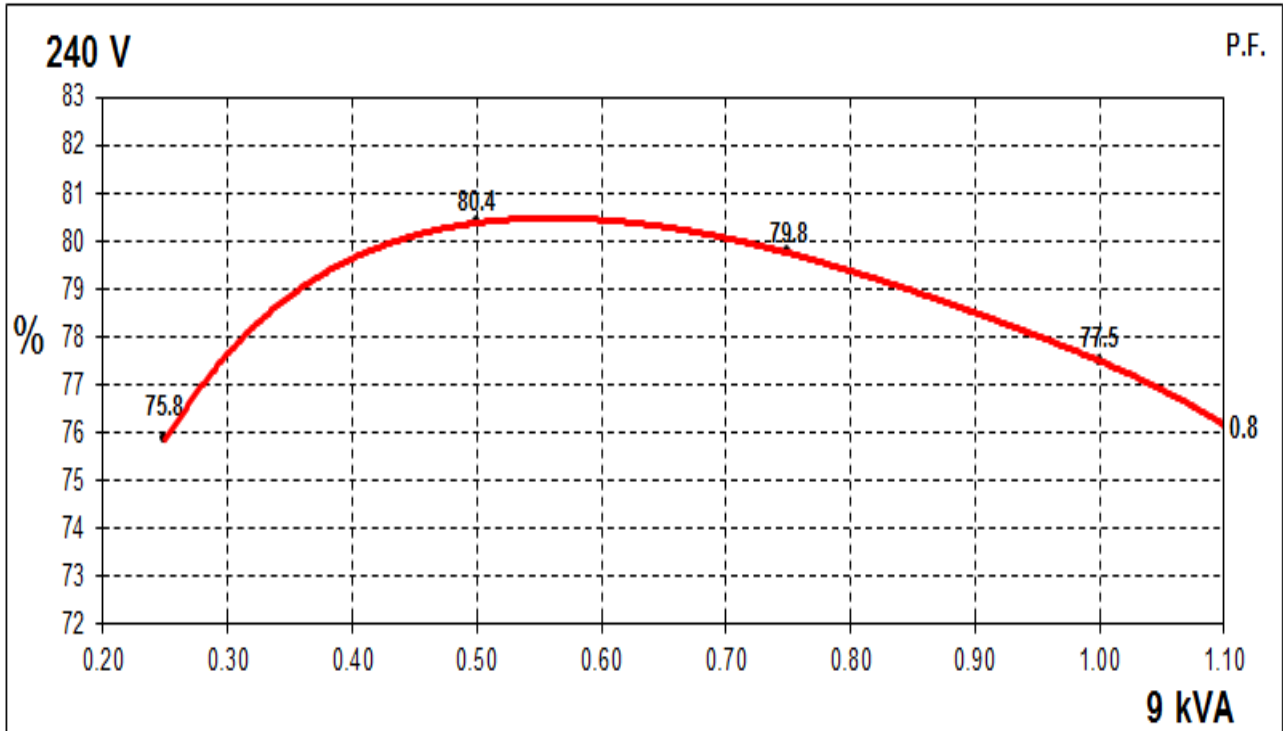


STAMFORD

S0L1-J1 Winding 06

Locked Rotor Motor Starting Curves

60Hz

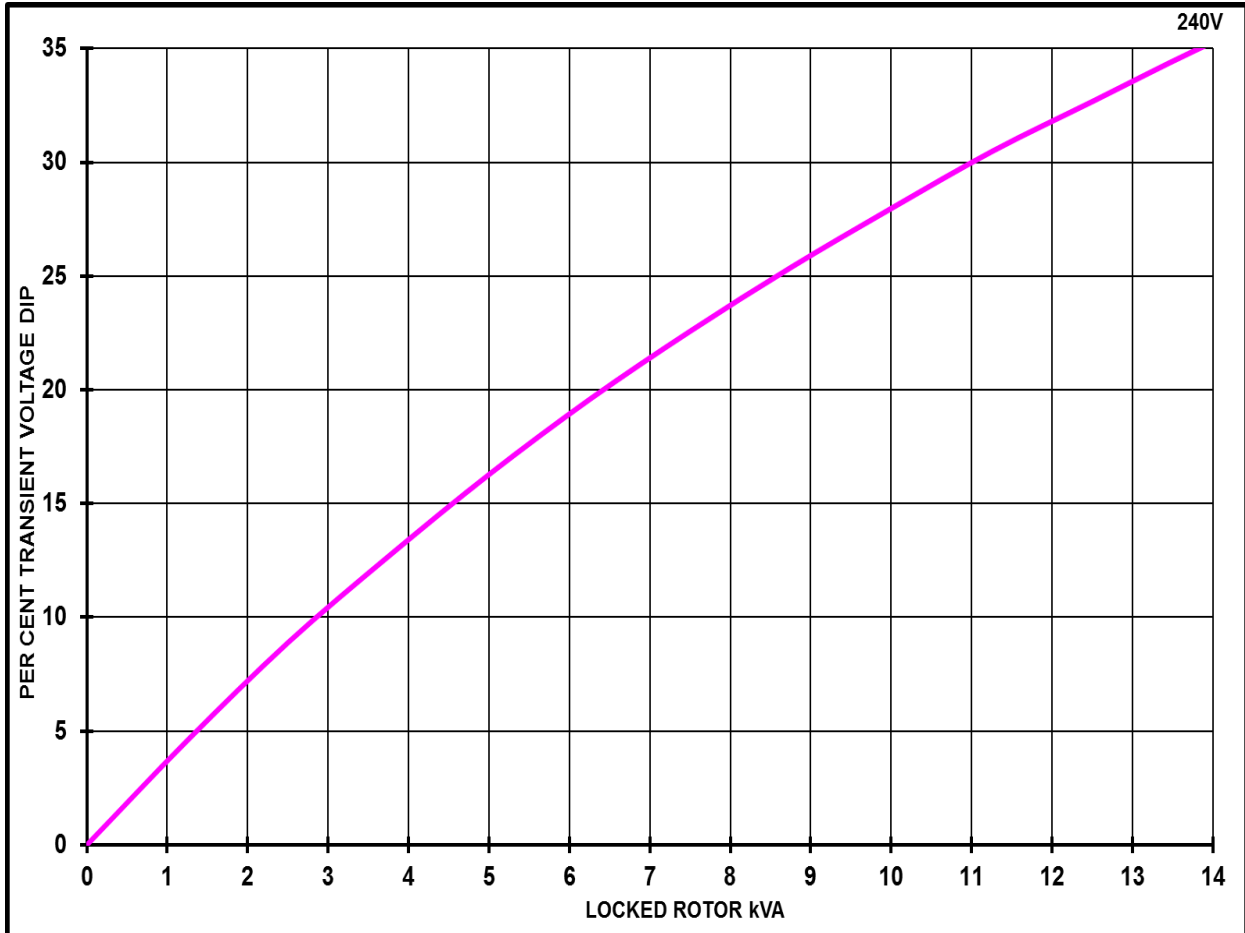


| Transient Voltage Dip Scaling Factor | | Transient Voltage Rise Scaling Factor |
|--------------------------------------|--------|---|
| PF | Factor | For voltage rise multiply voltage dip by 1.25 |
| < 0.5 | 1.00 | |
| 0.5 | 0.97 | |
| 0.6 | 0.93 | |
| 0.7 | 0.90 | |
| 0.8 | 0.85 | |
| 0.9 | 0.83 | |
| 1.0 | 0.80 | |

STAMFORD

S0L1-J1 Winding 06

Short Circuit Decrement Curve

60Hz

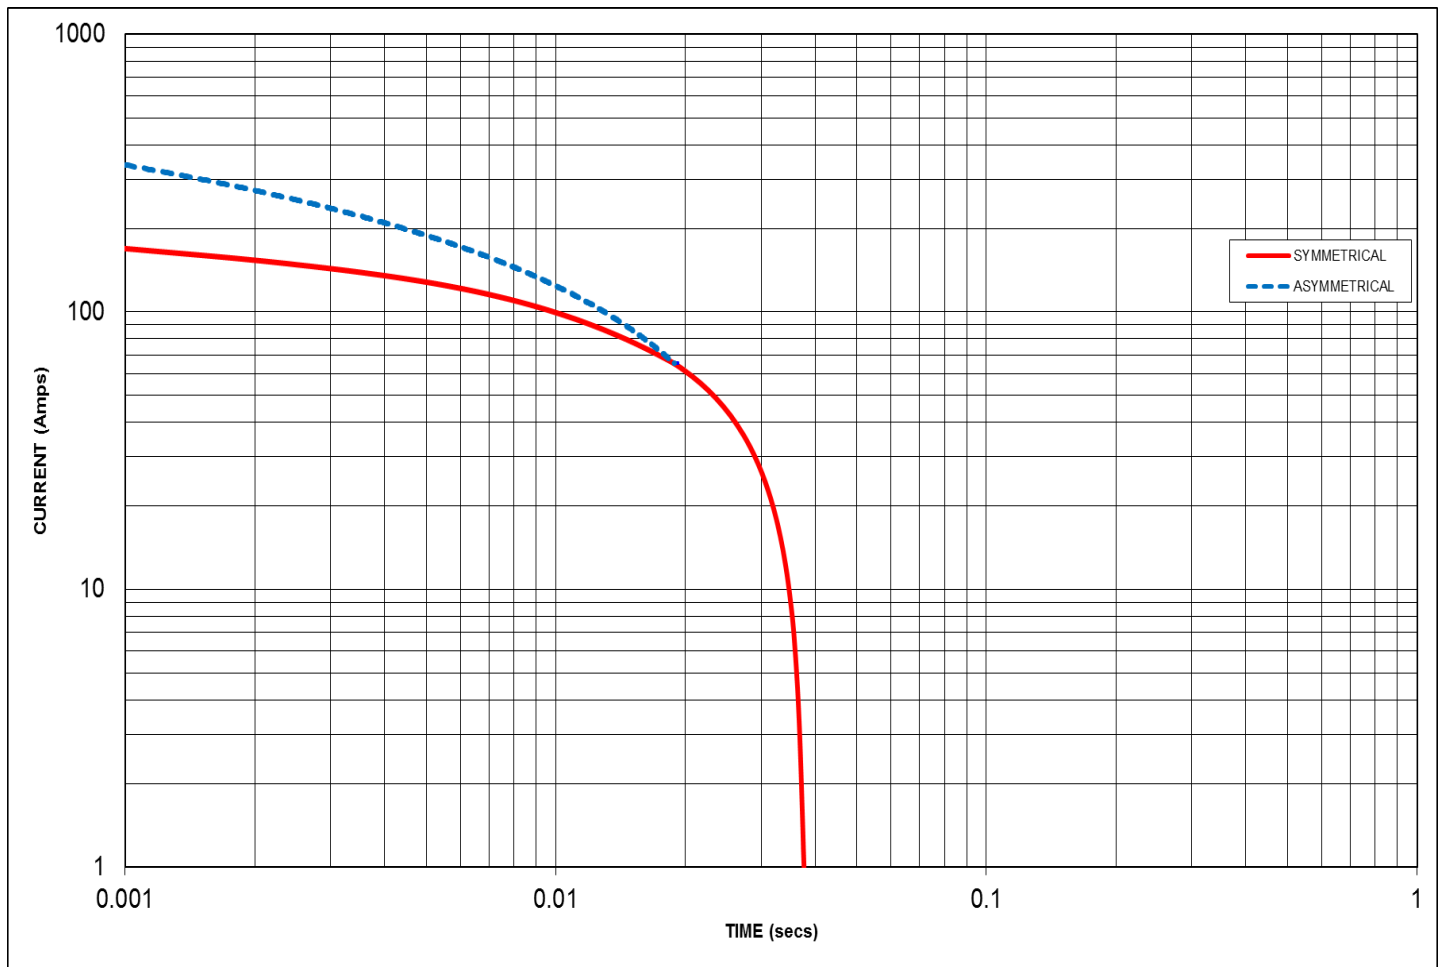


Sustained Short Circuit - N/A

STAMFORD

SOL1-J1 Winding 06

Typical Alternator Operating Chart

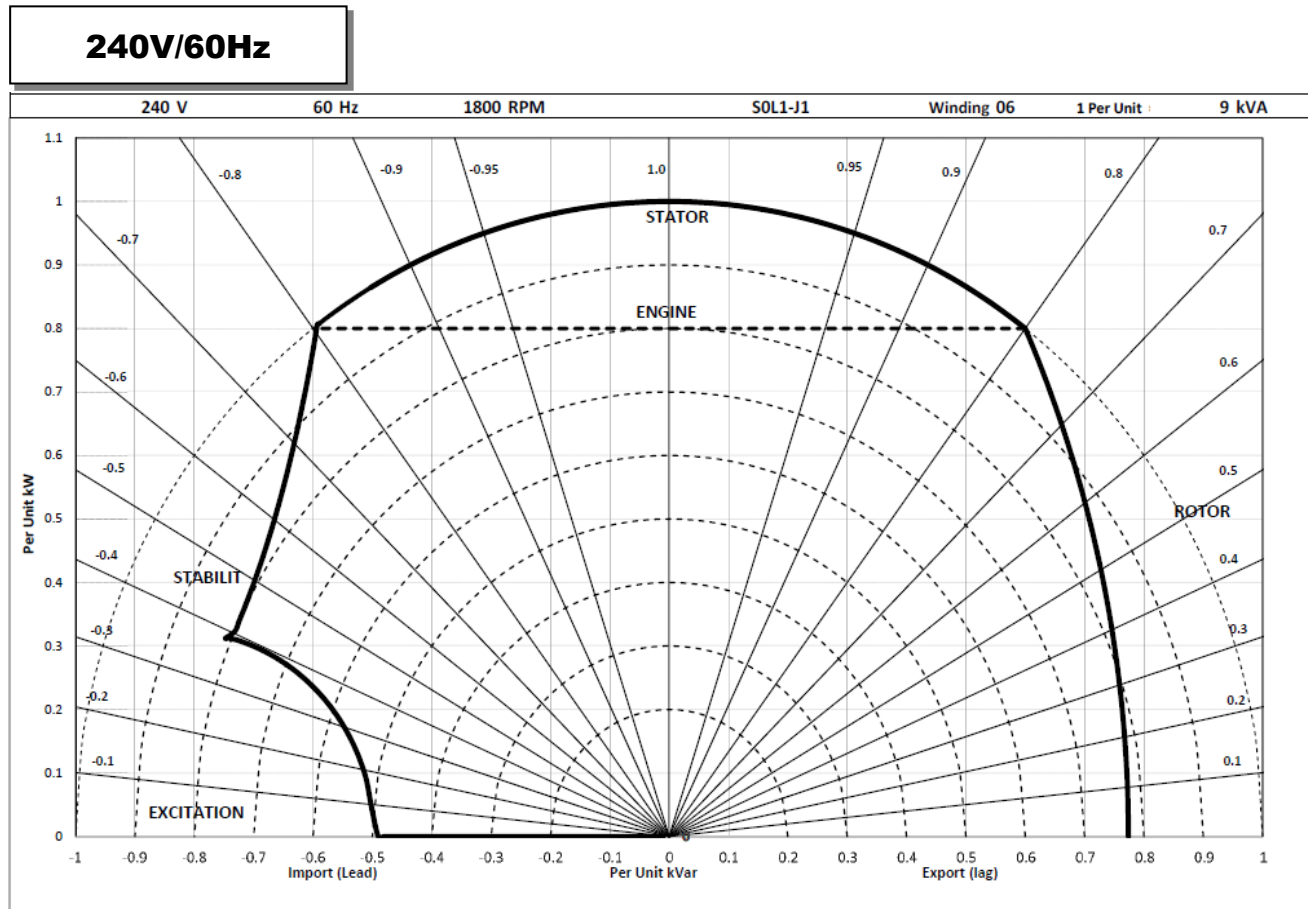

STAMFORD®

S0L1-J1 Winding 06

RATINGS AT 0.8/1.0 POWER FACTOR

| Class - Temp Rise | Standby - 163/27°C | Standby - 150/40°C | Cont. H - 125/40°C | Cont. F - 105/40°C |
|------------------------|--------------------|--------------------|--------------------|--------------------|
| 60 Series (V) | 240 240 | 240 240 | 240 240 | 240 240 |
| Hz Power Factor | 0.8 1.0 | 0.8 1.0 | 0.8 1.0 | 0.8 1.0 |
| kVA | 9.8 10.6 | 9.5 10.3 | 9.0 9.7 | 8.1 8.7 |
| kW | 7.8 10.6 | 7.6 10.3 | 7.2 9.7 | 6.5 8.7 |
| Efficiency (%) | 76.3 80.4 | 76.7 80.7 | 77.5 81.5 | 78.5 82.5 |
| kW Input | 10.3 13.2 | 9.9 12.8 | 9.3 11.9 | 8.3 10.5 |

De-Rates

All values tabulated above are subject to the following reductions:

- 3% for every 500 meters by which the operating altitude exceeds 1000 meters above mean sea level
- 3% for every 5°C by which the operational ambient temperature exceeds 40°C
- For any other operating conditions impacting the cooling circuit please refer to applications

Note: Requirement for operating in an ambient exceeding 60°C and altitude exceeding 4000 meters must be referred to applications.

Dimensional and Torsional Drawing

For dimensional and torsional information please refer to the alternator General Arrangement and rotor drawings available on our website (<http://stamford-avk.com/>)

Note: Continuous development of our products means that the information contained in our data sheets can change without notice, and specifications should always be confirmed with Cummins Generator Technologies prior to purchase.



Follow us @stamfordavk



Cummins Generator Technologies



View our videos at youtube.com/stamfordavk

news.stamford-avk.com

For Applications Support:
applications@cummins.com

For Customer Service:
service-engineers@stamford-avk.com

For General Enquiries:
info@cumminsgeneratortechnologies.com

Copyright 2016. Cummins Generator Technologies Ltd. All rights reserved.
Cummins and the Cummins logo are registered trade marks of Cummins Inc.
STAMFORD is a registered trade mark of Cummins Generator Technologies Ltd.

